


**ADDENDUM NO. 2**

**Sedgwick County Project: Drainage Channel Improvements from 87<sup>th</sup> to 79<sup>th</sup> Street South (D21)**

**The items contained herein now become a part of the referenced plans and specifications. Please read the following items and acknowledge receipt of this addendum on the Proposal Page Number P-1. NOTE: THIS ADDENDUM MUST BE ACKNOWLEDGED TO CONSTITUTE A VALID BID.**

***PLANS:***

- Replace Plan Sheet 9 with Plan Sheet 9R
  - Replace the General Note “concrete grade shall be 3.0” with “concrete grade 4.0 AE per KDOT specifications shall be used in Concrete Ditch Lining.”
  - Remove from the General Note the option to use macro fiber reinforcement.

By:   
\_\_\_\_\_  
Lynn T. Packer, P.E.  
Director of Public Works/County Engineer

**Date: June 15, 2023**



STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
KANSAS	D21	2023	9.R	33

**GENERAL NOTE**  
 All work and materials required for this construction shall be paid for by the ton of "Aggregate Ditch Lining (D<sub>50</sub>)".  
 Dumped aggregate shall be spread in reasonable conformity with the ditch section as shown and as directed by the Engineer.  
 Aggregate Ditch Lining shall be measured and paid for by the ton in the vehicle at the location designated by the Engineer and shall be full compensation for excavation for undercutting, furnishing, hauling, placing and maintaining the material as specified to complete the work.  
 The weight of the aggregate is based on a standard density of 120 PCF. When the standard density of the material is more or less than 120 PCF, the thickness may vary correspondingly.

◆ Backslope aggregate ditch lining, constructed as indicated on this sheet, shall be paid for by the ton of "Aggregate Ditch Lining (D<sub>50</sub>)."

QUANTITIES FOR TYPICAL 10' DITCH with 6:1 shoulder slope & 4:1 backslope						
Approx. Excavation per Station (cu.yd.)						
D <sub>50</sub>	T	▲	d = 1.0	d = 2.0	d = 3.0	d = 4.0
4"	12"	8"	68	99	130	161
6"	18"	12"	102	148	195	241

Note: Quantities provided for information only.  
 ● Aggregate larger than 4 inches (D<sub>50</sub>) should not be used within the clear zone.

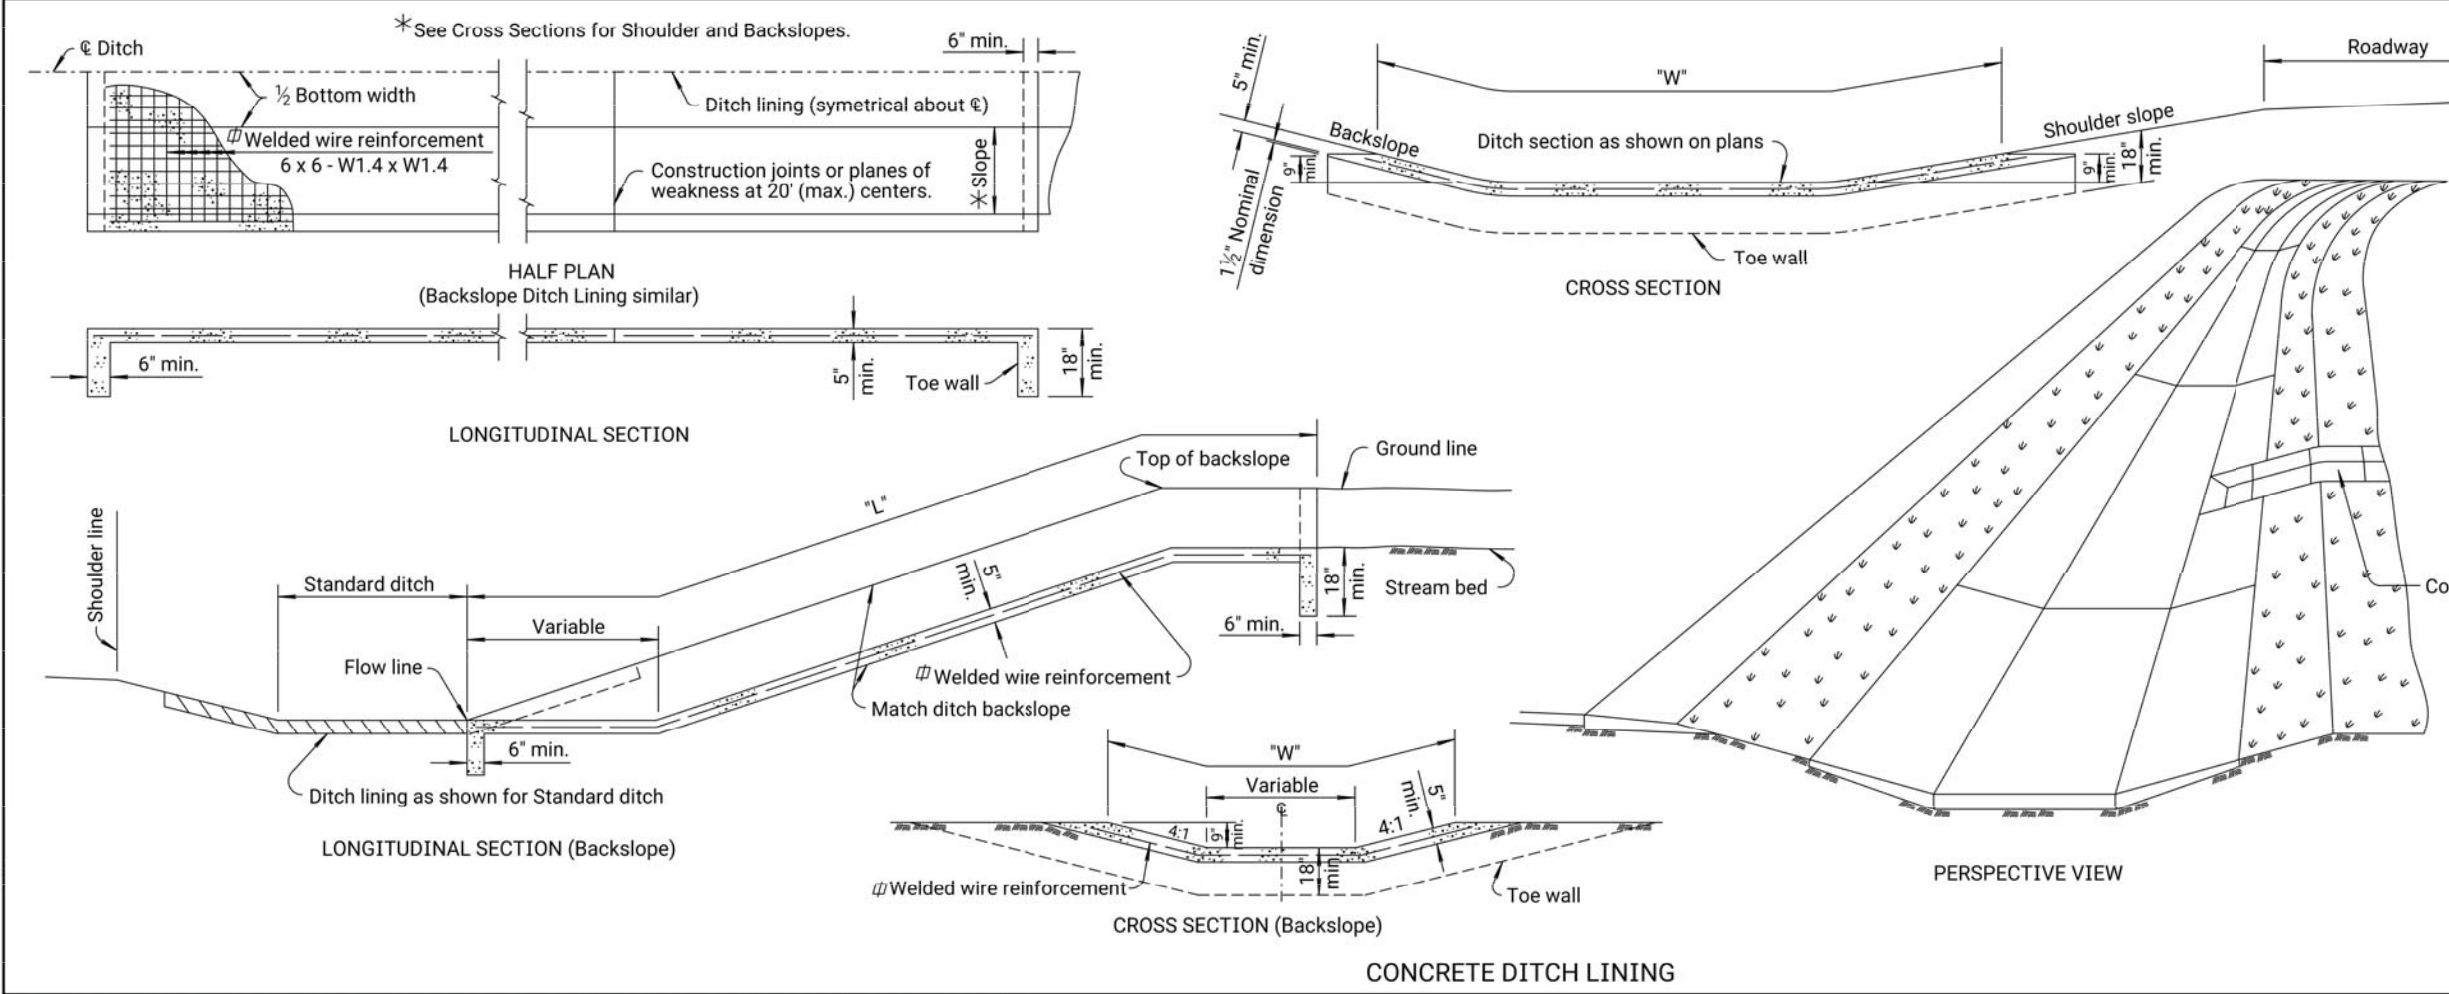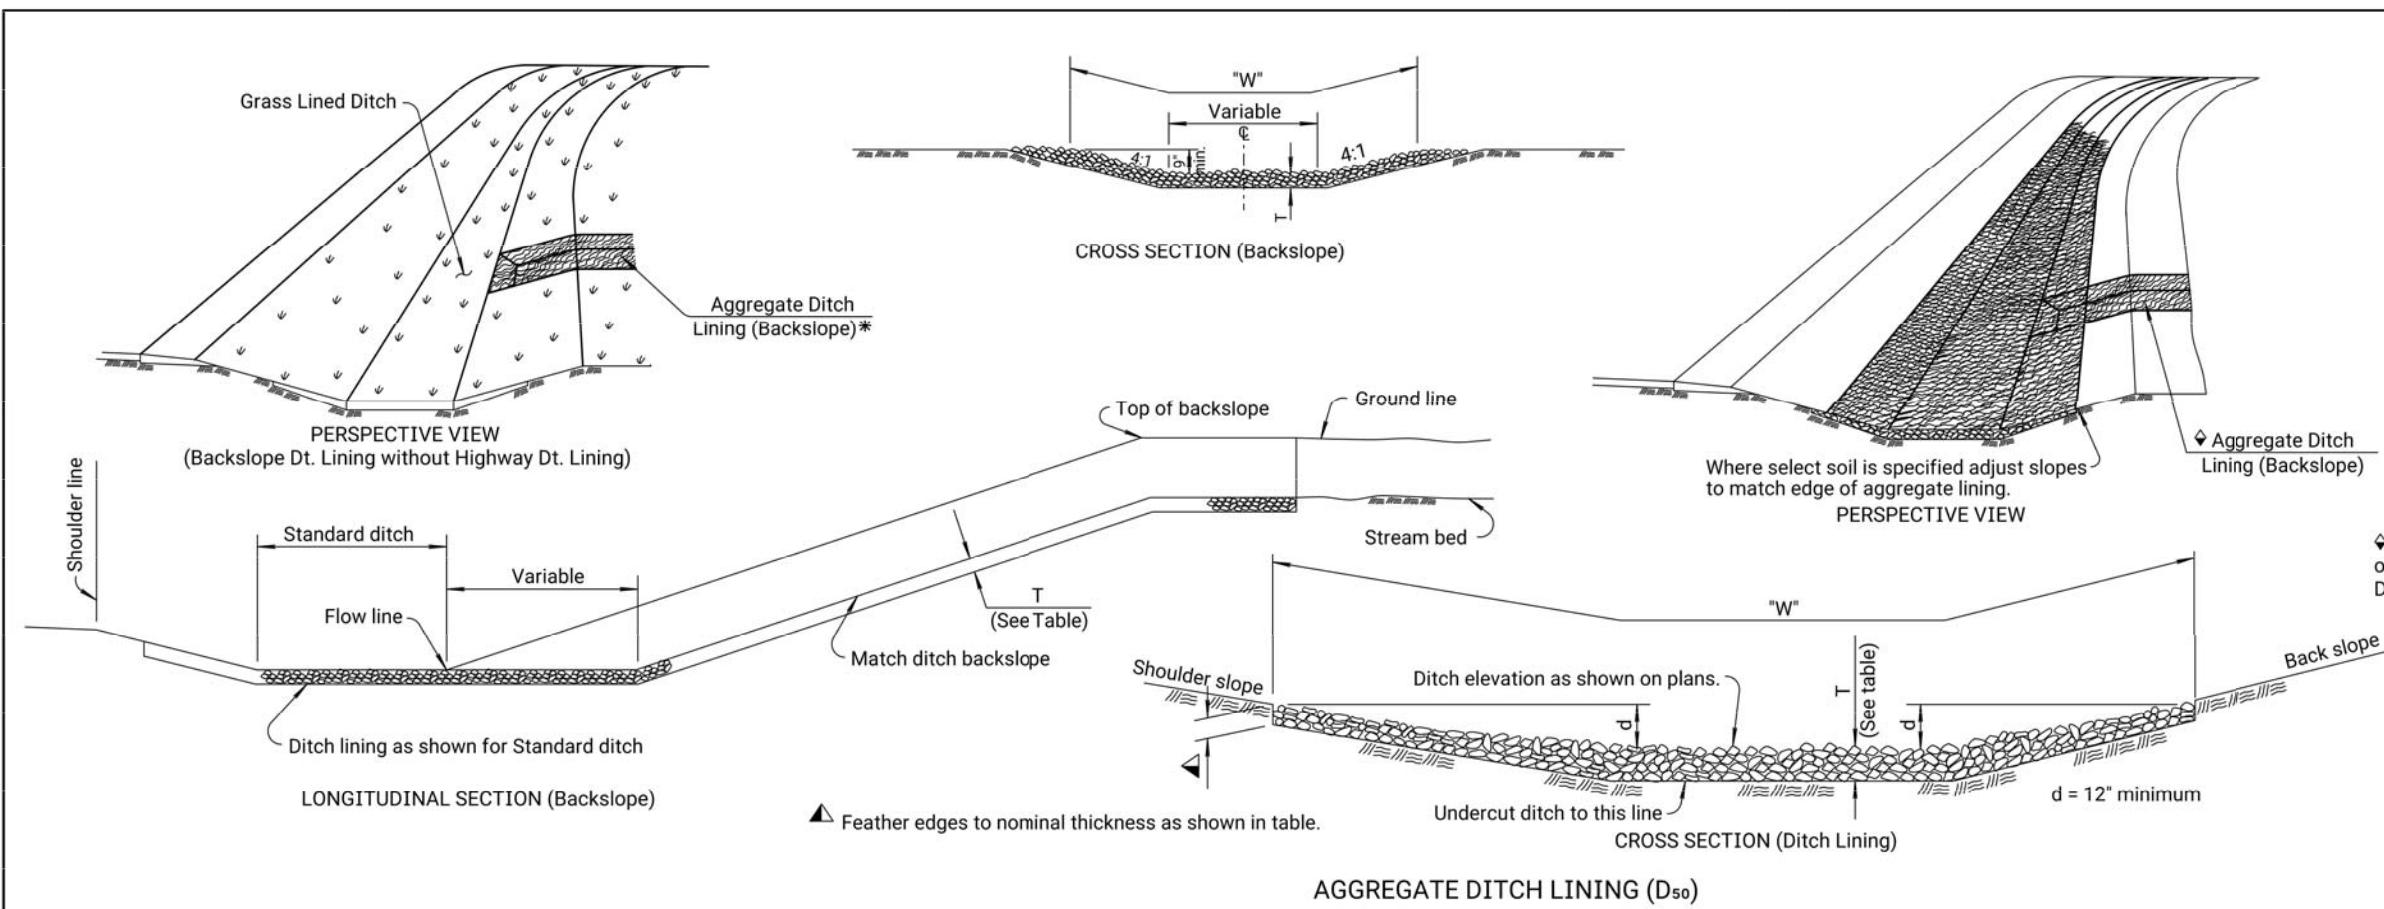

**GENERAL NOTE**  
 Concrete Grade 4.0 AE shall be used in Concrete Ditch Lining.  
 Welded wire reinforcement shall be of the electrically welded square mesh type with No. W1.4 wires spaced at 6" ctrs. each way.  
 Reinforcement as shown is included in the unit price bid for "Concrete Ditch Lining".  
 Measurements of Concrete Ditch Lining shall be in sq. yds. of outside surface area. Add 1'-6" times "W" for each toewall.  
 The exact location and dimensions may be adjusted, if required, by the Engineer at the time of construction.  
 Longitudinal construction joints may be constructed at the Contractor's option.  
~~Welded wire can be substituted with macro fiber reinforcement. See Standard Specifications for macro fiber and application rate requirements.~~

▲ 06-15-23 Concrete Grade Type and removal of fiber reinforcement option.

10	03-27-18	Added Aggregate Size in Clear Zone Guidance	A.L.R.	T.T.R.
09	08-01-12	Revised General Note	S.W.K.	J.O.B.
08	03-20-08	Rev. agg. edge thickness and quant.	S.W.K.	J.O.B.
NO.	DATE	REVISIONS	BY	APPD.

KANSAS DEPARTMENT OF TRANSPORTATION

**DITCH LINING**

RD502

FHWA APPROVAL	06-19-18	APPD.	Scott W. King
DESIGNED	DETAILED	QUANTITIES	TRACED
DESIGN CK.	DETAIL CK.	QUAN CK.	TRACE CK.

KDOT Graphics Certified 04-18-2022 9.R OF 33

Saved 5-2-2023 10:37:33 AM by CARLOS PEREZ  
 Plot Scale 1" = 6'-15-2023 2:47:56 PM by CARLOS PEREZ  
 U:\White-Civil\2020\0620\01\Main-Trans\Drawings\Revisions\0620-001-9 DITCH LINING.RD502

KDOT Graphics Certified